

CP830

Generation 6 *MX* Detection Range Manual Call Point

Features

- Compatible with *MX* Addressable Loop on SIMPLEX 4100ESi, VIGILANT *MX1* and VIGILANT MX4428 panels
- Red LED status indication
- EN54-11 certification
- Compact, modern styling
- Test key for fast testing
- Optional plastic cover

The CP830 *MX* Addressable weatherproof surface-mounting Manual Call Point has a plastic coated frangible element to ensure safe and reliable operation, producing no dangerous glass shards. It is operated by simply pressing on the centre of the frangible element until it snaps, releasing a microswitch, which signals an alarm at the *MX* Control and Indicating Equipment (CIE). The integral red LED indicator will illuminate when an alarm is registered and may be programmed to blink when the CP830 is polled by the CIE. The CP830 has an International Protection rating of IP67, making it suitable for outdoor applications. The CP830 does not have a formal UV exposure rating. Installation in full sun should be avoided. A transparent hinged cover can be fitted to help provide tamper protection. The cover must be lifted before the MCP can be operated.

Mounting

Mount the back box to a suitably flat surface in the required location, using the three fixing holes and screws provided in the installation kit. Ensure the cable entry holes are in the vertical plane. The back box can be mounted with either the single or double entry holes at the top.

Fit the appropriate cable glands into the 20mm diameter threaded holes as required. Use only the supplied spare washers to fit the respective cable glands or hole stoppers.

The 2 hole stoppers with plastic washers are provided for use where cable glands are not required. Ensure that all cable entry holes are securely sealed. The recommended sealant is Loctite 5331. Ensure that the gasket is correctly seated in its channel on the rear of the cover.

Place the call point squarely over the backbox and carefully push the call point until the locating clips have engaged.



Specifications

MX Loop Voltage ¹	20V to 40Vdc
Quiescent Current	275µA
Alarm State Current	2.8mA
Max. CP830 / Loop ²	250
Ambient Temperature	-25°C to +70°C
Storage Temperature	-40°C to +80°C
Relative Humidity	10% to 95% (non cond.)
Ingress Protection ³	IP67
Dimensions (HWD)	93 x 98 x 73mm
ActivFire Listed	afp-2798 (EN 54-11:2001)

Part Numbers

514.800.612	Manual Call Point
515.001.025	Frangible Glass Element (packet of 5)
515.001.127	Flexible Plastic Element
SC070	Test Key (packet of 10)
SU0615	Transparent Hinged Cover

1. Addressable loop voltage provided by *MX* CIE.


2. *MX1* CIE. Refer to appropriate CIE design manuals for IB units and Loop Loading specifications.

3. Note the CP830 does not have a formal UV exposure rating. Installation in full sun should be avoided.

Use the four fixing screws to lock the call point into place.

An Earth continuity terminal is situated in the rear of the back box; it is designed to accommodate 2 conductors of up to 2.5mm sq. An earthing plate is provided for continuity of metal conduits.

CP830 Wiring Details – Rear View

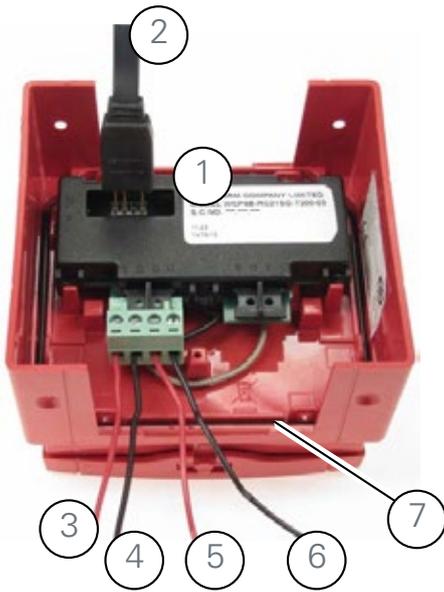

- 1 Ancillary programming port
- 2 Ancillary programming lead
- 3 Connected to Loop + IN
- 4 Connected to Loop - IN
- 5 Connected to Loop + OUT
- 6 Connected to Loop - OUT
- 7 Gasket

Cover Removal



Remove the four fixing screws used to lock the call point to the back box.

Place the edge of a large flat bladed screwdriver into the slot between the call point cover and the back box (item 8 at right).

Gently twist until the latches are disengaged.


Pull the cover away from the back box.

Address Setting

The CP830 is shipped with a default (invalid) address of 255 and must be set to the correct loop address using an *MX* address programming tool and lead. Ensure that the pins of the ancillary programming lead are inserted completely into the lower row of the programming port for effective communication with the address programming tool.

Testing

A test key is provided with each MCP allowing easy testing, without breaking the frangible element. The key is inserted into a slot in the base of the MCP, allowing the frangible element to drop away from the switch; activating it and registering an alarm at the CIE. Replacement frangible elements in glass or plastic are available.

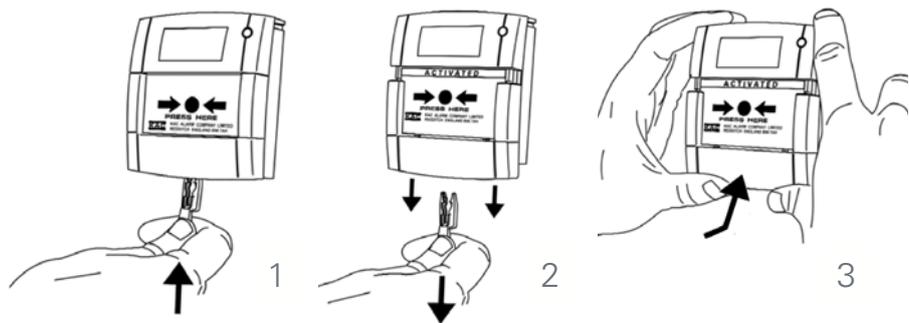

Australia Level 3, 95 Coventry Street Southbank VIC 3006 Tel: 1300 725 688 Tel: +61 3 9313 9700 Email: tfppcustservice.au@tycofp.com
 New Zealand 17 Mary Muller Drive Hillsborough PO Box 19-545 Woolston Christchurch 8241 Tel: +64 9 635 0617 Email: tsp.sales.nz@tycoint.com

VIGILANT, a respected regional brand of Johnson Controls, is a technology leader in the Australian and New Zealand fire detection markets with AS and NZS product approvals. The VIGILANT product line includes a comprehensive range of *MX TECHNOLOGY* fire detection products and the market-leading QE90 voice evacuation systems. VIGILANT product is widely supported throughout Australia and New Zealand by a network of installation companies, service companies and distributors.

© 2017 Johnson Controls. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.

CP830datVIG1710 October 2017

www.vigilant-fire.com.au