


Universal Baffle for D51 Duct Sampling Unit Installation Instructions

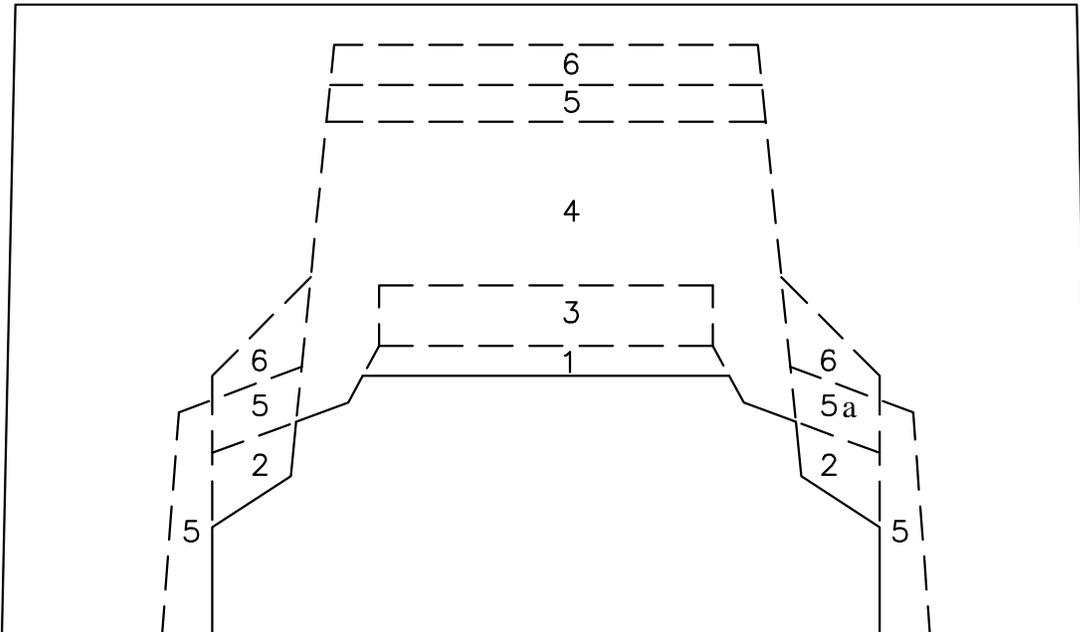

The following sections must be removed from the Universal Baffle to fit the profile of the respective detectors. Sections are removed by cutting or tearing along the perforations.

DETECTOR	BASE	REMOVE
P131A MK2	B501	NONE
614P	5B	1, 2, 3
814P / 814PH	4B-C	1, 2, 3
850P / 850PH	4B-C	1, 2, 3

Manufactured for: Johnson Controls
 Level 3, 95 Coventry Street, Southbank
 VIC 3006 AUSTRALIA
 Tel: 1300 725 688
www.tycosafetyproducts-anz.com

Copyright© 2017. Johnson Controls. All Rights Reserved.